

AUTOMATIC PROTECTION RELAY

Introduction

Automatic relay protection is a device used in power systems to automatically detect and respond abnormal conditions such as overcurrent, overvoltage, ground faults, etc. Alarms to protect electrical systems and equipment from potential hazards and ensure safe operation of electrical systems.

Blue Jay's power distribution safety-related products include Arc flash protection relays, Motor protection relays, WSK series, DH series switchgear temperature and humidity control equipment, etc. Products have miniature intelligence, high integration, high sensitivity and high precision, and has higher anti-electromagnetic interference performance and higher IP protection level. It is suitable for various monitoring sites to ensure electricity safety.




Main Features

- Automatic control, high reliability.
- Ability to record and analyze failure events.
- Modular design, convenient and quick installation and maintenance.
- Quick response: detect and cut off the faulty circuit in time to effectively prevent accidents.
- High-precision measurement and judgment ability, accurately judge the type and location of the fault.
- Versatility: such as overload protection, short circuit protection, ground fault protection, etc.
- 24 hours real-time monitoring, RS485 remote control.

Application

- Industrial automation system.
- Large municipal engineering project.
- UPS system, battery system.
- Real-time monitoring and alarm of power system.
- Substations, power plants, transmission lines, distribution lines.
- Protects motors from overloads, short circuits and motor failures.

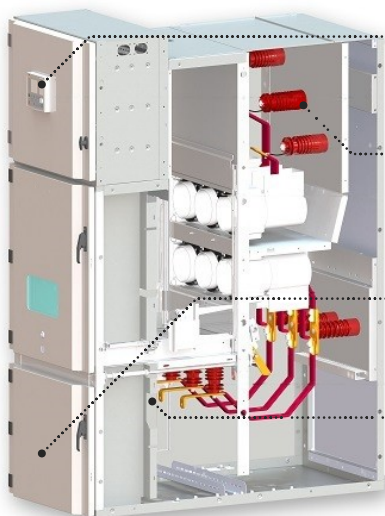

Integrated CB control panel

- CB switch status indicate
- CB switching operation
- Integrate PMD and other functions

Thermal Monitoring (SCM-W3000)

- Surface touch or infrared sensor
- Cable terminations
- CB contact fingers
- Busbar joints

Partial Discharge Monitoring (SCM-PD3000)

- TV and ultrasonic sensor
- PD detection
- PD localization

Arc Flash Protective (AFR)

- High precision fiber probe
- Arc detection
- Arc localization
- Fault protection

AFR SERIES ARC PROTECTION RELAY


BUSBAR PROTECTION RELAY




Introduction

AFR series arc protection relay detects electrical arcs in medium and low-voltage equipment, isolating power to minimize the risk of electrical fires. It works to prevent arcing faults in busbars, metal-clad switchgear, and cable boxes.

Arc flash relays can connect with remote light sensors to detect arc flashes and send a trip signal to cut off power. They can be used for stand-alone devices or embedded in complex switchgear layouts.

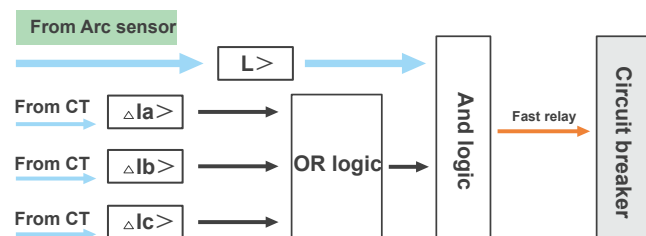

Arc Hazard Diagram

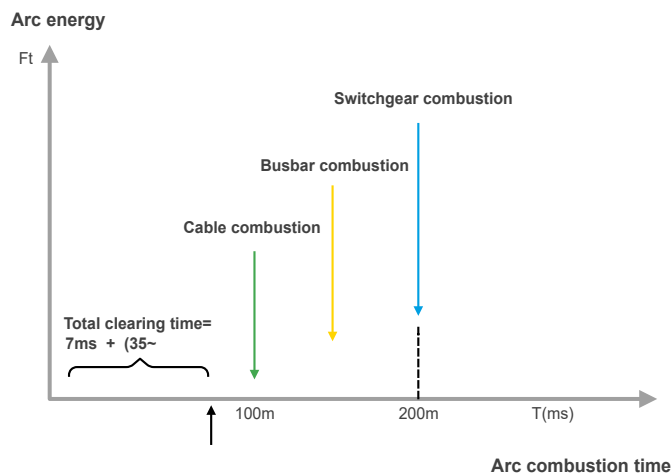

Main Features

- Accurate and real-time monitoring arc signals.
- High temperatures and humidity resistance.
- Fast response, relay tripping in less than 10 ms.
- Equipped with RS485 communication interface.
- Support ST visible light and ST ultraviolet sensor access.
- Complete SOE records, all information power-off retention.
- Support automatic reclosing function to improve system availability.

Application

- Capacitor cabinet.
- High voltage switchgear.
- Electric power substation.
- Large municipal engineering project.
- Medium and low voltage switchgear.
- Thermal power plant electrical section switchgear.
- Wind turbine & Wind farm and photovoltaic station switchgear.

AFR-M ARC FLASH PROTECTION RELAY

BUSBAR PROTECTION RELAY



Introduction

AFR-M busbar ARC flash protection relay represents a cost-effective and highly efficient solution designed to mitigate arc-fault damage. AFR-M detects the emitted light from an arc flash and promptly triggers tripping relay in both low-voltage (LV) and medium-voltage (MV) electrical networks.

Equipped with up to 48 ultraviolet optical sensors, the relay operates on preset programs, ensuring optimal protection for the secure operation of bus circuits.

Terminal Definition

A-Pwr board	B-DO relay board	C-Arc sensor terminal-1	D-Arc sensor terminal-2	E-Arc sensor terminal-3	F-Arc sensor terminal-4	G-DO Comm board	H-Current sensor terminal
A01 Terminal Label A02 I/O Channel A03 I/O Channel A04 I/O Channel A05 I/O Channel A06 I/O Channel A07 I/O Channel A08 I/O Channel A09 I/O Channel A10 I/O Channel A11 Arc Sensor C1 A12 Arc Sensor C2 A13 Arc Sensor C3 A14 Arc Sensor C4 A15 Arc Sensor C5 A16 Arc Sensor C6 A17 Arc Sensor C7 A18 Arc Sensor C8 A19 Arc Sensor C9 A20 Arc Sensor C10 A21 Arc Sensor C11 A22 Arc Sensor C12	B01 DO-1 B02 DO-1 B03 DO-2 B04 DO-2 B05 DO-3 B06 DO-3 B07 DO-4 B08 DO-4 B09 DO-5 B10 DO-5 B11 DO-6 B12 DO-6 B13 DO-7 B14 DO-7 B15 DO-8 B16 DO-8 B17 DO-9 B18 DO-9 B19 DO-10 B20 DO-10 B21 DO-11 B22 DO-11	C01 ARC01 C02 ARC02 C03 ARC03 C04 ARC04 C05 ARC05 C06 ARC06 C07 ARC07 C08 ARC08 C09 ARC09 C10 ARC10 C11 ARC11 C12 ARC12	D01 ARC13 D02 ARC14 D03 ARC15 D04 ARC16 D05 ARC17 D06 ARC18 D07 ARC19 D08 ARC20 D09 ARC21 D10 ARC22 D11 ARC23 D12 ARC24	E01 ARC25 E02 ARC26 E03 ARC27 E04 ARC28 E05 ARC29 E06 ARC30 E07 ARC31 E08 ARC32 E09 ARC33 E10 ARC34 E11 ARC35 E12 ARC36	F01 ARC37 F02 ARC38 F03 ARC39 F04 ARC40 F05 ARC41 F06 ARC42 F07 ARC43 F08 ARC44 F09 ARC45 F10 ARC46 F11 ARC47 F12 ARC48	G01 RS485+ G02 RS485- G03 RS485+ G04 RS485- G05 RS485+ G06 RS485- G07 RS485+ G08 RS485-	H01 I01 I02 I03 H02 I04 I05 I06 H03 I07 I08 I09 H04 I10 I11 I12 H05 I13 I14 I15 H06 I16 I17 I18 H07 I19 I20 I21 H08 I22 I23 I24 H09 I25 I26 I27 H10 I28 I29 I30 H11 I31 I32 I33 H12 I34 I35 I36 H13 I37 I38 I39 H14 I40 I41 I42 H15 I43 I44 I45 H16 I46 I47 I48 H17 I49 I50 I51 H18 I52 I53 I54 H19 I55 I56 I57 H20 I58 I59 I60 H21 I61 I62 I63 H22 I64 I65 I66 H23 I67 I68 I69 H24 I70 I71 I72 H25 I73 I74 I75 H26 I76 I77 I78 H27 I79 I80 I81 H28 I82 I83 I84 H29 I85 I86 I87 H30 I88 I89 I90 H31 I91 I92 I93 H32 I94 I95 I96 H33 I97 I98 I99 H34 I100 I101 I102 H35 I103 I104 I105 H36 I106 I107 I108 H37 I109 I110 I111 H38 I112 I113 I114 H39 I115 I116 I117 H40 I118 I119 I120 H41 I121 I122 I123 H42 I124 I125 I126 H43 I127 I128 I129 H44 I130 I131 I132 H45 I133 I134 I135 H46 I136 I137 I138 H47 I139 I140 I141 H48 I142 I143 I144 H49 I145 I146 I147 H50 I148 I149 I150 H51 I151 I152 I153 H52 I154 I155 I156 H53 I157 I158 I159 H54 I160 I161 I162 H55 I163 I164 I165 H56 I166 I167 I168 H57 I169 I170 I171 H58 I172 I173 I174 H59 I175 I176 I177 H60 I178 I179 I180 H61 I181 I182 I183 H62 I184 I185 I186 H63 I187 I188 I189 H64 I190 I191 I192 H65 I193 I194 I195 H66 I196 I197 I198 H67 I199 I200 I201 H68 I202 I203 I204 H69 I205 I206 I207 H70 I208 I209 I210 H71 I211 I212 I213 H72 I214 I215 I216 H73 I217 I218 I219 H74 I220 I221 I222 H75 I223 I224 I225 H76 I226 I227 I228 H77 I229 I230 I231 H78 I232 I233 I234 H79 I235 I236 I237 H80 I238 I239 I240 H81 I241 I242 I243 H82 I244 I245 I246 H83 I247 I248 I249 H84 I250 I251 I252 H85 I253 I254 I255 H86 I256 I257 I258 H87 I259 I260 I261 H88 I262 I263 I264 H89 I265 I266 I267 H90 I268 I269 I270 H91 I271 I272 I273 H92 I274 I275 I276 H93 I277 I278 I279 H94 I280 I281 I282 H95 I283 I284 I285 H96 I286 I287 I288 H97 I289 I290 I291 H98 I292 I293 I294 H99 I295 I296 I297 H100 I298 I299 I300 H101 I301 I302 I303 H102 I304 I305 I306 H103 I307 I308 I309 H104 I310 I311 I312 H105 I313 I314 I315 H106 I316 I317 I318 H107 I319 I320 I321 H108 I322 I323 I324 H109 I325 I326 I327 H110 I328 I329 I330 H111 I331 I332 I333 H112 I334 I335 I336 H113 I337 I338 I339 H114 I340 I341 I342 H115 I343 I344 I345 H116 I346 I347 I348 H117 I349 I350 I351 H118 I352 I353 I354 H119 I355 I356 I357 H120 I358 I359 I360 H121 I361 I362 I363 H122 I364 I365 I366 H123 I367 I368 I369 H124 I370 I371 I372 H125 I373 I374 I375 H126 I376 I377 I378 H127 I379 I380 I381 H128 I382 I383 I384 H129 I385 I386 I387 H130 I388 I389 I390 H131 I391 I392 I393 H132 I394 I395 I396 H133 I397 I398 I399 H134 I400 I401 I402 H135 I403 I404 I405 H136 I406 I407 I408 H137 I409 I410 I411 H138 I412 I413 I414 H139 I415 I416 I417 H140 I418 I419 I420 H141 I421 I422 I423 H142 I424 I425 I426 H143 I427 I428 I429 H144 I430 I431 I432 H145 I433 I434 I435 H146 I436 I437 I438 H147 I439 I440 I441 H148 I442 I443 I444 H149 I445 I446 I447 H150 I448 I449 I450 H151 I451 I452 I453 H152 I454 I455 I456 H153 I457 I458 I459 H154 I460 I461 I462 H155 I463 I464 I465 H156 I466 I467 I468 H157 I469 I470 I471 H158 I472 I473 I474 H159 I475 I476 I477 H160 I478 I479 I480 H161 I481 I482 I483 H162 I484 I485 I486 H163 I487 I488 I489 H164 I490 I491 I492 H165 I493 I494 I495 H166 I496 I497 I498 H167 I499 I500 I501 H168 I502 I503 I504 H169 I505 I506 I507 H170 I508 I509 I510 H171 I511 I512 I513 H172 I514 I515 I516 H173 I517 I518 I519 H174 I520 I521 I522 H175 I523 I524 I525 H176 I526 I527 I528 H177 I529 I530 I531 H178 I532 I533 I534 H179 I535 I536 I537 H180 I538 I539 I540 H181 I541 I542 I543 H182 I544 I545 I546 H183 I547 I548 I549 H184 I550 I551 I552 H185 I553 I554 I555 H186 I556 I557 I558 H187 I559 I560 I561 H188 I562 I563 I564 H189 I565 I566 I567 H190 I568 I569 I570 H191 I571 I572 I573 H192 I574 I575 I576 H193 I577 I578 I579 H194 I580 I581 I582 H195 I583 I584 I585 H196 I586 I587 I588 H197 I589 I590 I591 H198 I592 I593 I594 H199 I595 I596 I597 H200 I598 I599 I600 H201 I601 I602 I603 H202 I604 I605 I606 H203 I607 I608 I609 H204 I610 I611 I612 H205 I613 I614 I615 H206 I616 I617 I618 H207 I619 I620 I621 H208 I622 I623 I624 H209 I625 I626 I627 H210 I628 I629 I630 H211 I631 I632 I633 H212 I634 I635 I636 H213 I637 I638 I639 H214 I640 I641 I642 H215 I643 I644 I645 H216 I646 I647 I648 H217 I649 I650 I651 H218 I652 I653 I654 H219 I655 I656 I657 H220 I658 I659 I660 H221 I661 I662 I663 H222 I664 I665 I666 H223 I667 I668 I669 H224 I670 I671 I672 H225 I673 I674 I675 H226 I676 I677 I678 H227 I679 I680 I681 H228 I682 I683 I684 H229 I685 I686 I687 H230 I688 I689 I690 H231 I691 I692 I693 H232 I694 I695 I696 H233 I697 I698 I699 H234 I700 I701 I702 H235 I703 I704 I705 H236 I706 I707 I708 H237 I709 I710 I711 H238 I712 I713 I714 H239 I715 I716 I717 H240 I718 I719 I720 H241 I721 I722 I723 H242 I724 I725 I726 H243 I727 I728 I729 H244 I730 I731 I732 H245 I733 I734 I735 H246 I736 I737 I738 H247 I739 I740 I741 H248 I742 I743 I744 H249 I745 I746 I747 H250 I748 I749 I750 H251 I751 I752 I753 H252 I754 I755 I756 H253 I757 I758 I759 H254 I760 I761 I762 H255 I763 I764 I765 H256 I766 I767 I768 H257 I769 I770 I771 H258 I772 I773 I774 H259 I775 I776 I777 H260 I778 I779 I780 H261 I781 I782 I783 H262 I784 I785 I786 H263 I787 I788 I789 H264 I790 I791 I792 H265 I793 I794 I795 H266 I796 I797 I798 H267 I799 I800 I801 H268 I802 I803 I804 H269 I805 I806 I807 H270 I808 I809 I810 H271 I811 I812 I813 H272 I814 I815 I816 H273 I817 I818 I819 H274 I820 I821 I822 H275 I823 I824 I825 H276 I826 I827 I828 H277 I829 I830 I831 H278 I832 I833 I834 H279 I835 I836 I837 H280 I838 I839 I840 H281 I841 I842 I843 H282 I844 I845 I846 H283 I847 I848 I849 H284 I850 I851 I852 H285 I853 I854 I855 H286 I856 I857 I858 H287 I859 I860 I861 H288 I862 I863 I864 H289 I865 I866 I867 H290 I868 I869 I870 H291 I871 I872 I873 H292 I874 I875 I876 H293 I877 I878 I879 H294 I880 I881 I882 H295 I883 I884 I885 H296 I886 I887 I888 H297 I889 I890 I891 H298 I892 I893 I894 H299 I895 I896 I897 H300 I898 I899 I900 H301 I901 I902 I903 H302 I904 I905 I906 H303 I907 I908 I909 H304 I910 I911 I912 H305 I913 I914 I915 H306 I916 I917 I918 H307 I919 I920 I921 H308 I922 I923 I924 H309 I925 I926 I927 H310 I928 I929 I930 H311 I931 I932 I933 H312 I934 I935 I936 H313 I937 I938 I939 H314 I940 I941 I942 H315 I943 I944 I945 H316 I946 I947 I948 H317 I949 I950 I951 H318 I952 I953 I954 H319 I955 I956 I957 H320 I958 I959 I960 H321 I961 I962 I963 H322 I964 I965 I966 H323 I967 I968 I969 H324 I970 I971 I972 H325 I973 I974 I975 H326 I976 I977 I978 H327 I979 I980 I981 H328 I982 I983 I984 H329 I985 I986 I987 H330 I988 I989 I990 H331 I991 I992 I993 H332 I994 I995 I996 H333 I997 I998 I999 H334 I1000 I1001 I1002 H335 I1003 I1004 I1005 H336 I1006 I1007 I1008 H337 I1009 I1010 I1011 H338 I1012 I1013 I1014 H339 I1015 I1016 I1017 H340 I1018 I1019 I1020 H341 I1021 I1022 I1023 H342 I1024 I1025 I1026 H343 I1027 I1028 I1029 H344 I1030 I1031 I1032 H345 I1033 I1034 I1035 H346 I1036 I1037 I1038 H347 I1039 I1040 I1041 H348 I1042 I1043 I1044 H349 I1045 I1046 I1047 H350 I1048 I1049 I1050 H351 I1051 I1052 I1053 H352 I1054 I1055 I1056 H353 I1057 I1058 I1059 H354 I1060 I1061 I1062 H355 I1063 I1064 I1065 H356 I1066 I1067 I1068 H357 I1069 I1070 I1071 H358 I1072 I1073 I1074 H359 I1075 I1076 I1077 H360 I1078 I1079 I1080 H361 I1081 I1082 I1083 H362 I1084 I1085 I1086 H363 I1087 I1088 I1089 H364 I1090 I1091 I1092 H365 I1093 I1094 I1095 H366 I1096 I1097 I1098 H367 I1099 I1100 I1101 H368 I1102 I1103 I1104 H369 I1105 I1106 I1107 H370 I1108 I1109 I1110 H371 I1111 I1112 I1113 H372 I1114 I1115 I1116 H373 I1117 I1118 I1119 H374 I1120 I1121 I1122 H375 I1123 I1124 I1125 H376 I1126 I1127 I1128 H377 I1129 I1130 I1131 H378 I1132 I1133 I1134 H379 I1135 I1136 I1137 H380 I1138 I1139 I1140 H381 I1141 I1142 I1143 H382 I1144 I1145 I1146 H383 I1147 I1148 I1149 H384 I1150 I1151 I1152 H385 I1153 I1154 I1155 H386 I1156 I1157 I1158 H387 I1159 I1160 I1161 H388 I1162 I1163 I1164 H389 I1165 I1166 I1167 H390 I1168 I1169 I1170 H391 I1171 I1172 I1173 H392 I1174 I1175 I1176 H393 I1177 I1178 I1179 H394 I1180 I1181 I1182 H395 I1183 I1184 I1185 H396 I1186 I1187 I1188 H397 I1189 I1190 I1191 H398 I1192 I1193 I1194 H399 I1195 I1196 I1197 H400 I1198 I1199 I1200 H401 I1201 I1202 I1203 H402 I1204 I1205 I1206 H403 I1207 I1208 I1209 H404 I1210 I1211 I1212 H405 I1213 I1214 I1215 H406 I1216 I1217 I1218 H407 I1219 I1220 I1221 H408 I1222 I1223 I1224 H409 I1225 I1226 I1227 H410 I1228 I1229 I1230 H411 I1231 I1232 I1233 H412 I1234 I1235 I1236 H413 I1237 I1238 I1239 H414 I1240 I1241 I1242 H415 I1243 I1244 I1245 H416 I1246 I1247 I1248 H417 I1249 I1250 I1251 H418 I1252 I1253 I1254 H419 I1255 I1256 I1257 H420 I1258 I1259 I1260 H421 I1261 I1262 I1263 H422 I1264 I1265 I1266 H423 I1267 I1268 I1269 H424 I1270 I1271 I1272 H425 I1273 I1274 I1275 H426 I1276 I1277 I1278 H427 I1279 I1280 I1281 H428 I1282 I1283 I1284 H429 I1285 I1286 I1287 H430 I1288 I1289 I1290 H431 I1291 I1292 I1293 H432 I1294 I1295 I1296 H433 I1297 I1298 I1299 H434 I1300 I1301 I1302 H435 I1303 I1304 I1305 H436 I1306 I1307 I1308 H437 I1309 I1310 I1311 H438 I1312 I1313 I1314 H439 I1315 I1316 I1317 H440 I1318 I1319 I1320 H441 I1321 I1322 I1323 H442 I1324 I1325 I1326 H443 I1327 I1328 I1329 H444 I1330 I1331 I1332 H445 I1333 I1334 I1335 H446 I1336 I1337 I1338 H447 I1339 I1340 I1341 H448 I1342 I1343 I1344 H449 I1345 I1346 I1347 H450 I1348 I1349 I1350 H451 I1351 I1352 I1353 H452 I1354 I1355 I1356 H453 I1357 I1358 I1359 H454 I1360 I1361 I1362 H455 I1363 I1364 I1365 H456 I1366 I1367 I1368 H457 I1369 I1370 I1371 H458 I1372 I1373 I1374 H459 I1375 I1376 I1377 H460 I1378 I1379 I1380 H461 I1381 I1382 I1383 H462 I1384 I1385 I1386 H463 I1387 I1388 I1389 H464 I1390 I1391 I1392 H465 I1393 I1394 I1395 H466 I1396 I1397 I1398 H467 I1399 I1400 I1401 H468 I1402 I1403 I1404 H469 I1405 I1406 I1407 H470 I1408 I1409 I1410 H471 I1411 I1412 I1413 H472 I1414 I1415 I1416 H473 I1417 I1418 I1419 H474 I1420 I1421 I1422 H475 I1423 I1424 I1425 H476 I1426 I1427 I1428 H477 I1429 I1430 I1431 H478 I1432 I1433 I1434 H479 I1435 I1436 I1437 H480 I1438 I1439 I1440 H481 I1441 I1442 I1443 H482 I1444 I1445 I1446 H483 I1447 I1448 I1449 H484 I1450 I1451 I1452 H485 I1453 I1454 I1455 H486 I1456 I1457 I1458 H487 I1459 I1460 I1461 H488 I1462 I1463 I1464 H489 I1465 I1466 I1467 H490 I1468 I1469 I1470 H491 I1471 I1472 I1473 H492 I1474 I1475 I1476 H493 I1477 I1478 I1479 H494 I1480 I1481 I1482 H495 I1483 I1484 I1485 H496 I1486 I1487 I1488 H497 I1489 I1490 I1491 H498 I1492 I1493 I1494 H499 I1495 I1496 I1497 H500 I1498 I1499 I1500 H501 I1501 I1502 I1503 H502 I1504 I1505 I1506 H503 I1507 I1508 I1509 H504 I1510 I1511 I1512 H505 I1513 I1514 I1515 H506 I1516 I1517 I1518 H507 I1519 I1520 I1521 H508 I1522 I1523 I1524 H509 I1525 I1526 I1527 H510 I1528 I1529 I1530 H511 I1531 I1532 I1533 H512 I1534 I1535 I1536 H513 I1537 I1538 I1539 H514 I1540 I1541 I1542 H515 I1543 I1544 I1545 H516 I1546 I1547 I1548 H517 I1549 I1550 I1551 H518 I1552 I1553 I1554 H519 I1555 I1556 I1557 H520 I1558 I1559 I1560 H521 I1561 I1562 I1563 H522 I1

AFR-3S ARC FLASH PROTECTION RELAY

BUSBAR PROTECTION RELAY




Introduction

AFR-3S Arc flash protection relays serve as crucial components for detecting arc faults in electrical systems, ensuring the protection of equipment and personnel. AFR-3 adopts advanced monitoring of parameters such as current, voltage, and electric power to swiftly identify arcs.

Designed for application in medium and high-voltage power distribution systems, control cabinets, transformers, generators, motors, and various electrical equipment, the AFR-3 Arc flash relay operates based on a dual-criteria principle. Combining arc light detection with overcurrent detection, it delivers rapid protection responses and high reliability.


Terminal Definition

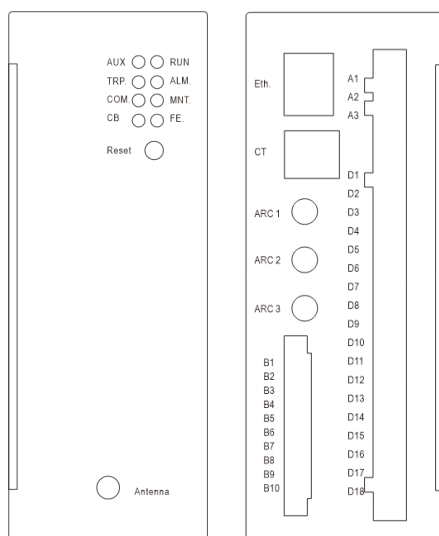

Main Features

- Advanced electrical power parameter monitoring.
- Fast response, Identify arc faults in electrical systems.
- Effectively reduce the risk of fire in electrical systems.
- Quickly cut off the power supply to protect electrical safety.
- Adopt the dual criterion of arc detection and overcurrent detection.
- Comprehensive SOE record for analysis and system optimization.

Wiring Method

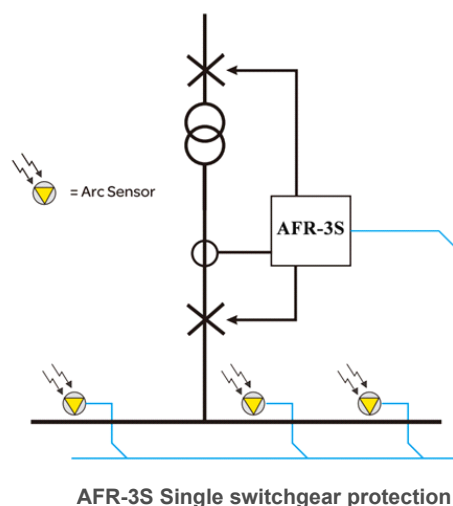

AFR-4 ARC FLASH PROTECTION RELAY

BUSBAR PROTECTION RELAY



Introduction

AFR-4 is a versatile and independently operating device for bay based protection. It supports 4-channels arc signal detection and can configuration multiple arc tripping modes, ensuring accurate and fast fault isolation. With a fast relay output speed up to 5ms, AFR-4 can minimize or completely eliminate arc flash damage, improving system safety and reliability. It can be used in various arc protection applications in low or medium voltage power distribution system.


AFR-4 also provides flash warning and dual criteria tripping mechanism (arc detection + current), providing a comprehensive solution for arc flash protection. Integrated RS485/Modbus communication enables seamless remote monitoring and control, which is ideal for modern power systems.

Main Features


- $\leq 5\text{ms}$ fast relay tripping;
- Regional arc light detection
- Multiple combined tripping modes;
- Circuit breaker failure protection;
- 4 channels of arc light signals detection;
- Dual criteria for arc detection and overcurrent detection;
- Integrated /RS485 MODBUS communication protocol;
- Support ST visible light and ST ultraviolet sensor access.

Typical Wiring


Mode 1: local tripping

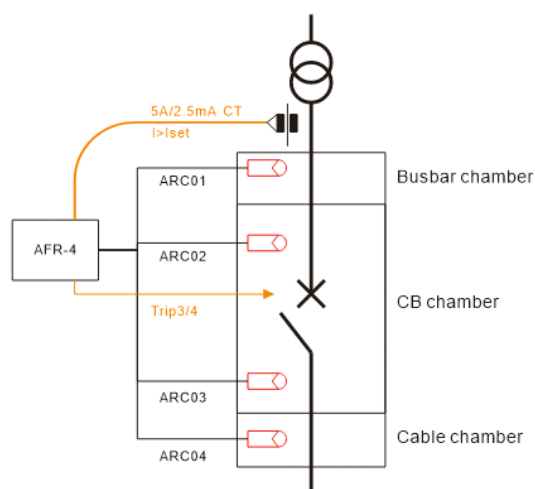

Mode 2: Zone tripping

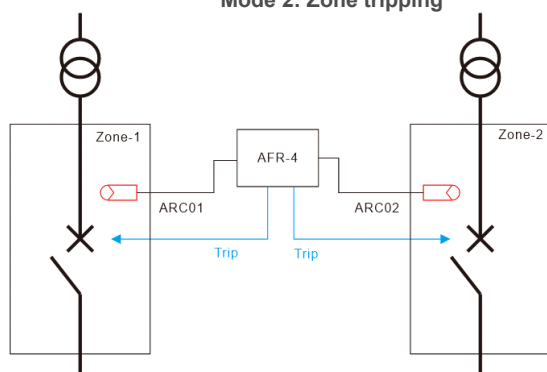

MT Mode: Master station tripping

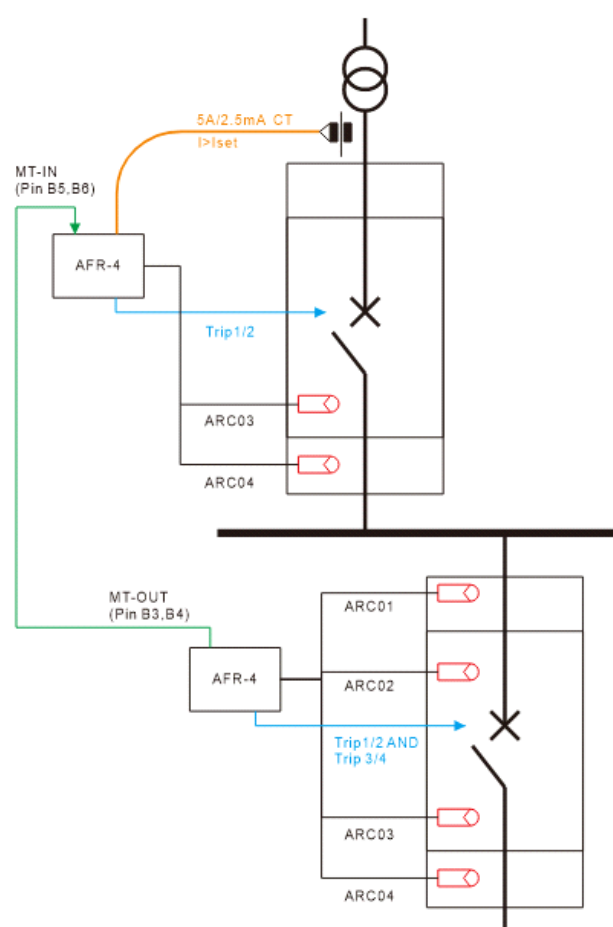

Technical Characteristics

	AFR-M	AFR-3S	AFR-4
Basic parameter			
Power supply	85~265V AC/DC, optional 24/48V DC	85~265V AC/DC	
Consumption	Monitoring <8W; DO triggered <10W		
Protection range	0~20 In	0.06~10 In	
Rated current (In)	5A or 1A		
Burden	<0.5VA		
Protect current accuracy	<4%		
Protect frequency accuracy	0.1Hz		
Arc signal input & control			
Channels number	12-48	3	4
Sensor type	Optical fiber		
Detection light type	Visible light/UV light (optional)		
Trip coil contact	AC250V/8A fast relay, passive node		
Trip operation time	Pure arc protection: ≤10ms Overcurrent + arc protection: ≤20ms		Pure arc protection: ≤8ms Overcurrent + arc protection: ≤15ms
DO relay channels	9	4/6 (optional)	6
Safety isolation	Photoelectric isolation, isolation voltage 2500V		
RS485 Communication			
Comm port	RS485 Modbus-RTU (one standard, two optional)		
Isolation type	Photoelectric isolation, lightning protection		
Baud rate	9600bps		
Ethernet communication			
Interface	2-Way Ethernet optional		
Network parameters	10M/100M adaptive		
Default IP	192.168.12.2/192.168.13.2		
Others			
Working environment	-10 ~ 55°C, < 93% RH (Non-condensing)		
Storage environment	-30 ~ 70°C, < 70% RH (Non-condensing)		
Relative humidity	5%~95%		
Atmospheric pressure	60kPa~106kPa		

Related Accessories



SCM-OPUV (UV light detection)

- Detection angle: 0-240°
- Photosensitive threshold: 1-10mw/cm²
- Default trigger threshold: 5mw/ cm²



SCM-OPVL1 (Visible light detection)

- Detection angle: 0-240°
- Max.transmission distance: <30 m
- Photosensitive threshold: 5-20KLUX.



SCM-OPVL2 (Visible light detection)

- Detection angle: 0-360°.
- Photosensitive threshold: 5-20KLUX
- Trigger threshold: 8KLUX